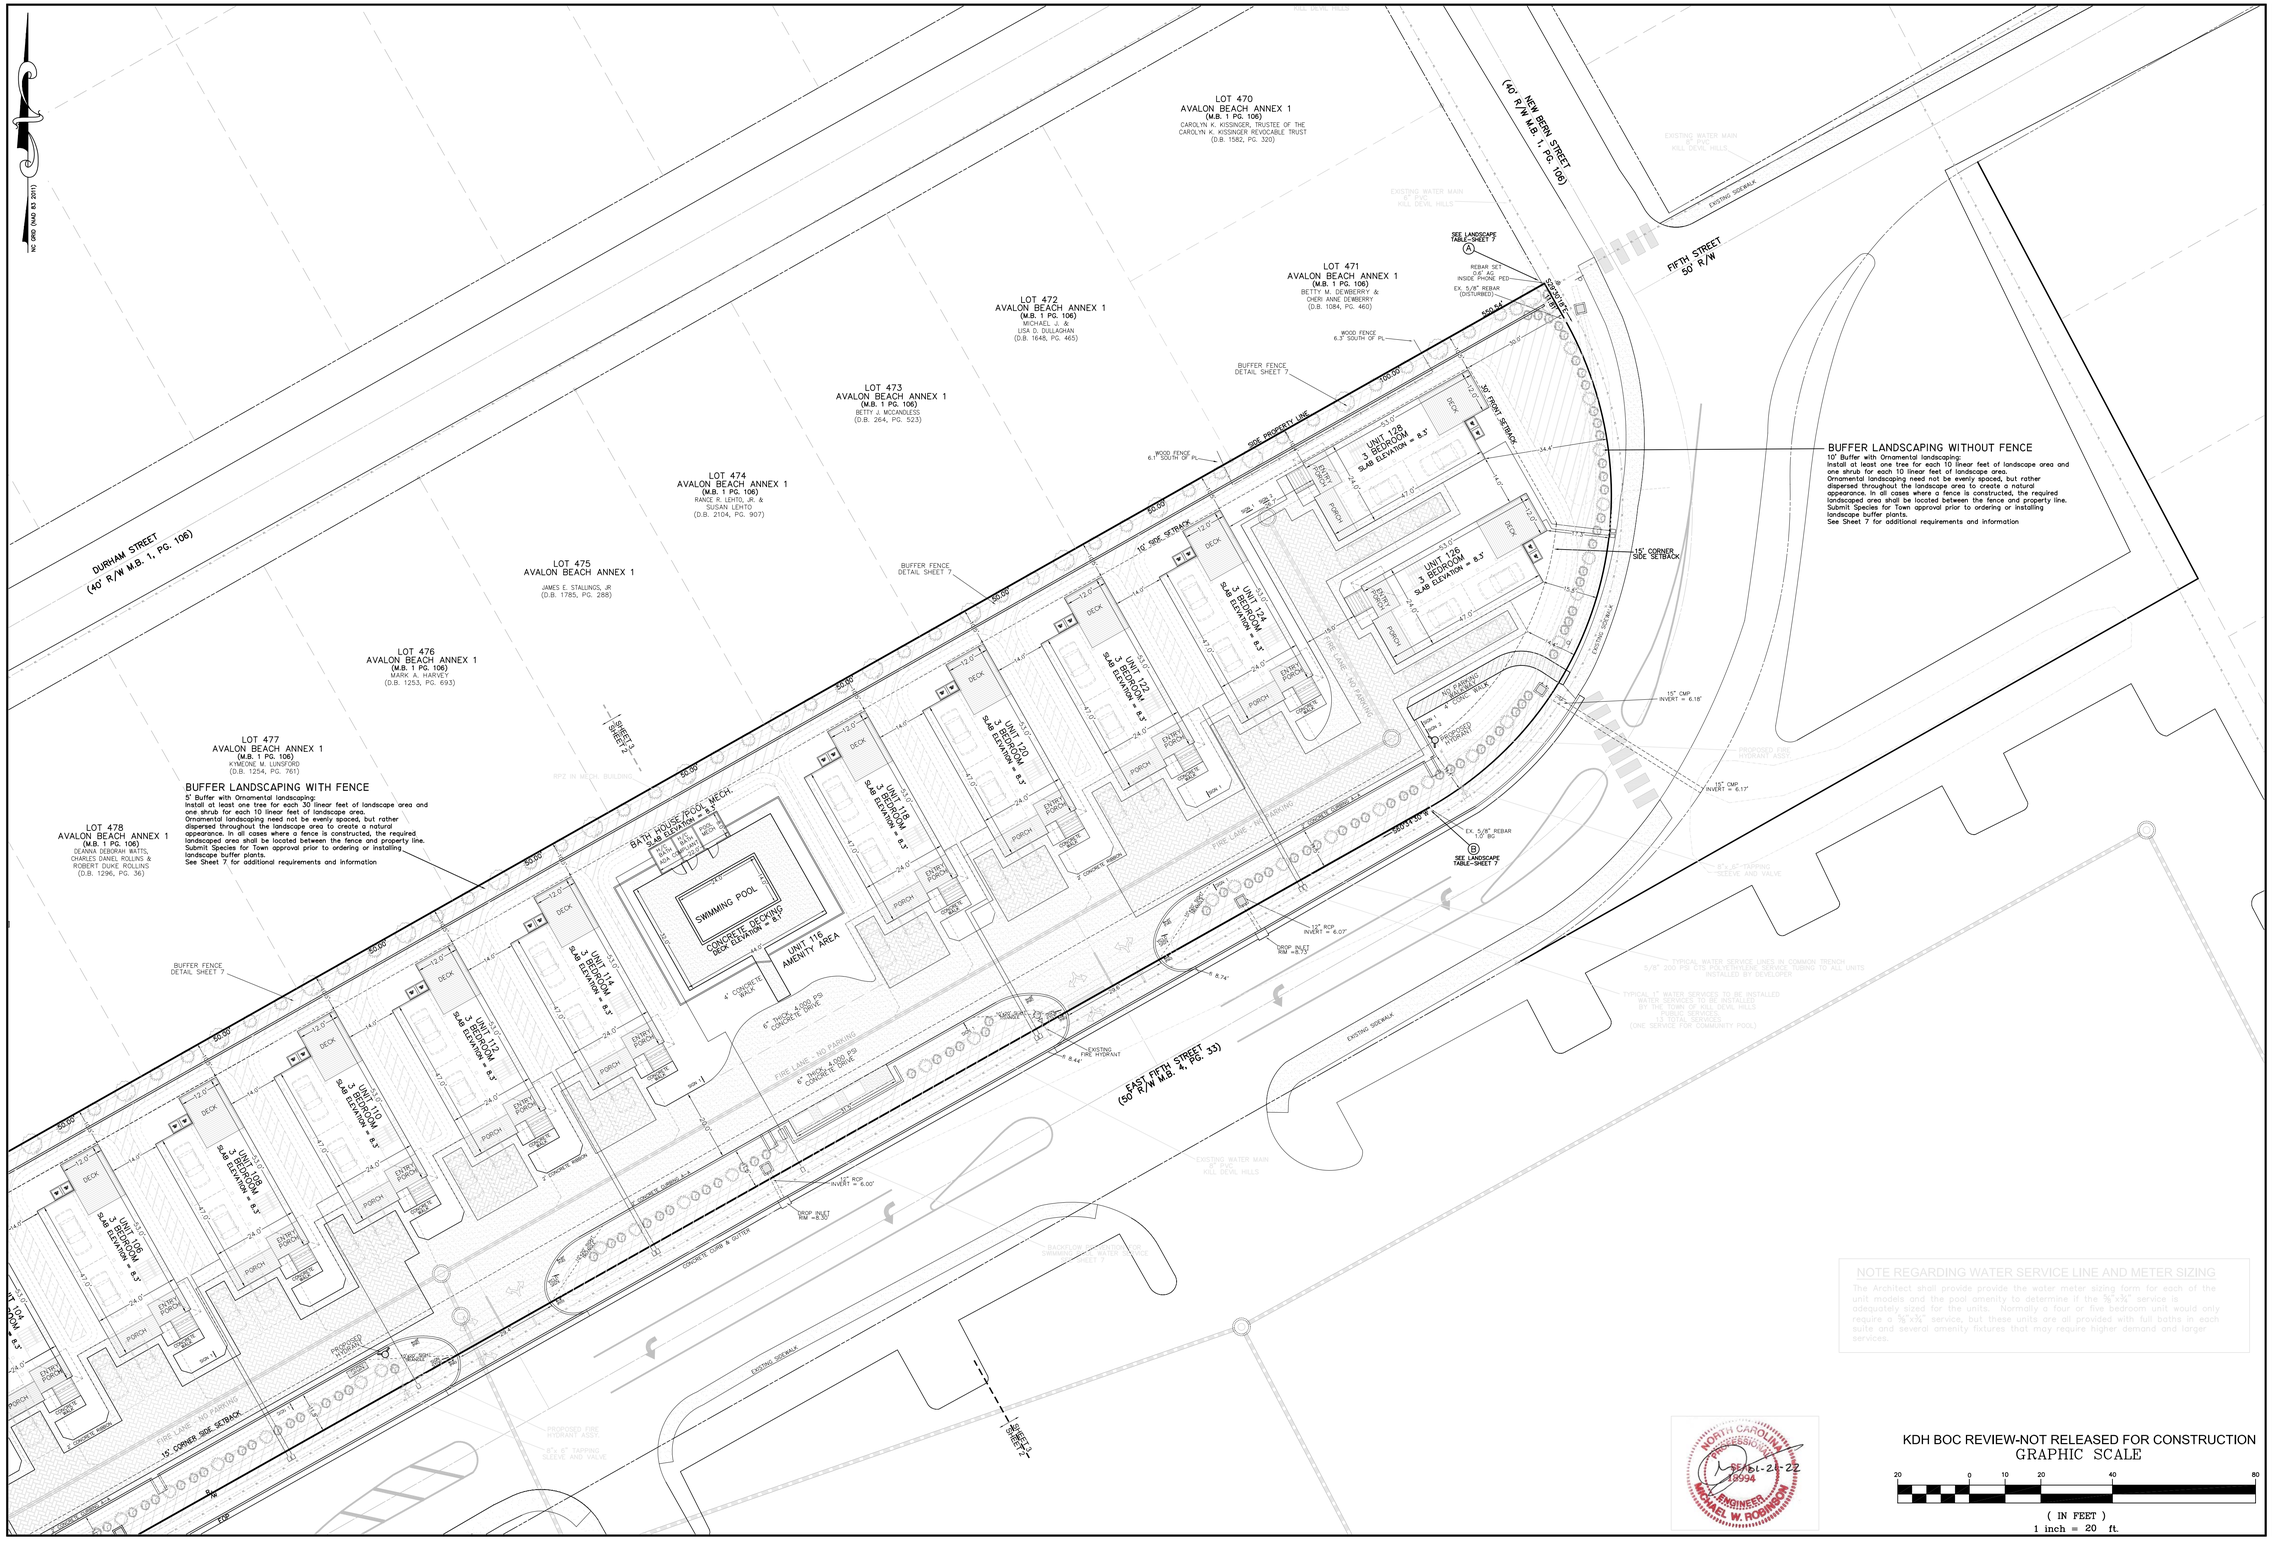

NOTE REGARDING WATER SERVICE LINE AND METER SIZING

The Architect shall provide provide the water meter sizing form for each of the unit models and the pool amenity to determine if the ¾"×¾" service is adequately sized for the units. Normally a four or five bedroom unit would only require a ¾"×¾" service, but these units are all provided with full baths in each suite and several amenity fixtures that may require higher demand and larger services.

NORTH CAROLINA PROFESSIONAL ENGINEER SEAL 18994 MICHAEL W. ROBINSON 01-21-22

KDH BOC REVIEW-NOT RELEASED FOR CONSTRUCTION

GRAPHIC SCALE

20 0 10 20 40 80

(IN FEET)
1 inch = 20 ft.

MICHAEL W. ROBINSON, P.E., P.L.S.
ENGINEERING AND SURVEYING
P.O. BOX 2852
KILL DEVIL HILLS, NC 27948
PHONE: 252-255-8026
EMAIL: mrobinson@obxengineering.com

SITE PLAN
PRELIMINARY

NORTH CAROLINA PROFESSIONAL ENGINEER SEAL 18994 MICHAEL W. ROBINSON

REVISIONS

NO.	DATE	DESCRIPTION	BY
	02-21-22	REV. FOR KDH REVIEW	MWR

PROJECT:
FIFTH STREET COTTAGES
KILL DEVIL HILLS — DARE COUNTY — NORTH CAROLINA

A PORTION OF TRACT 4, WRIGHT'S SHORES

DATE: 01-31-22	SCALE: 1"=20'
DESIGNED: MWR	DRAWN: MWR
SHEET: 3 OF 9	
CAD FILE: fifth street cottage court-kdh-base.dwg	
PROJECT NO: 051121	